

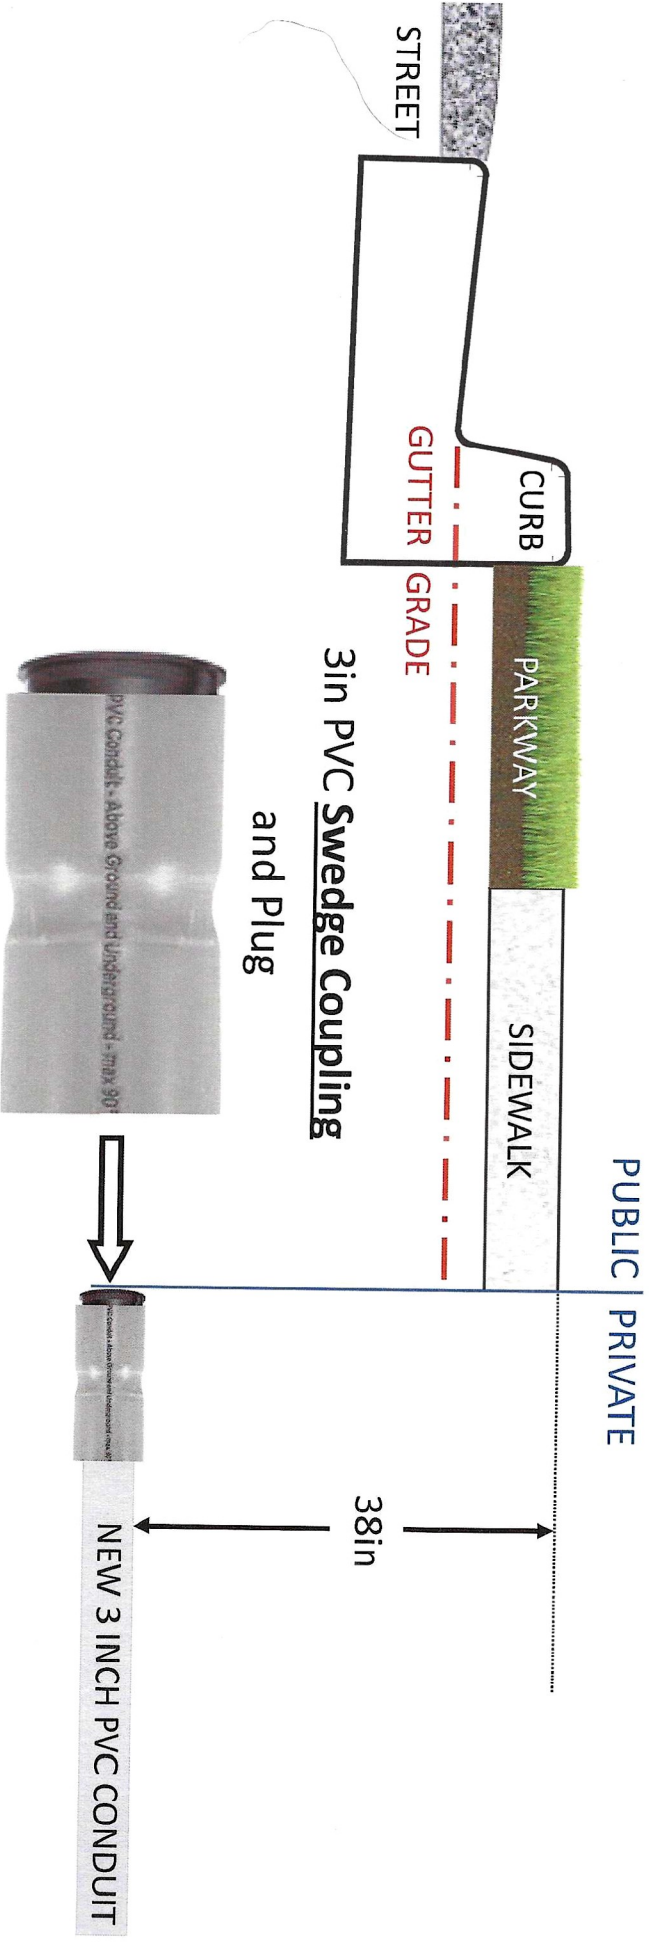




Future Underground Conduit Installed to the Public Property Line

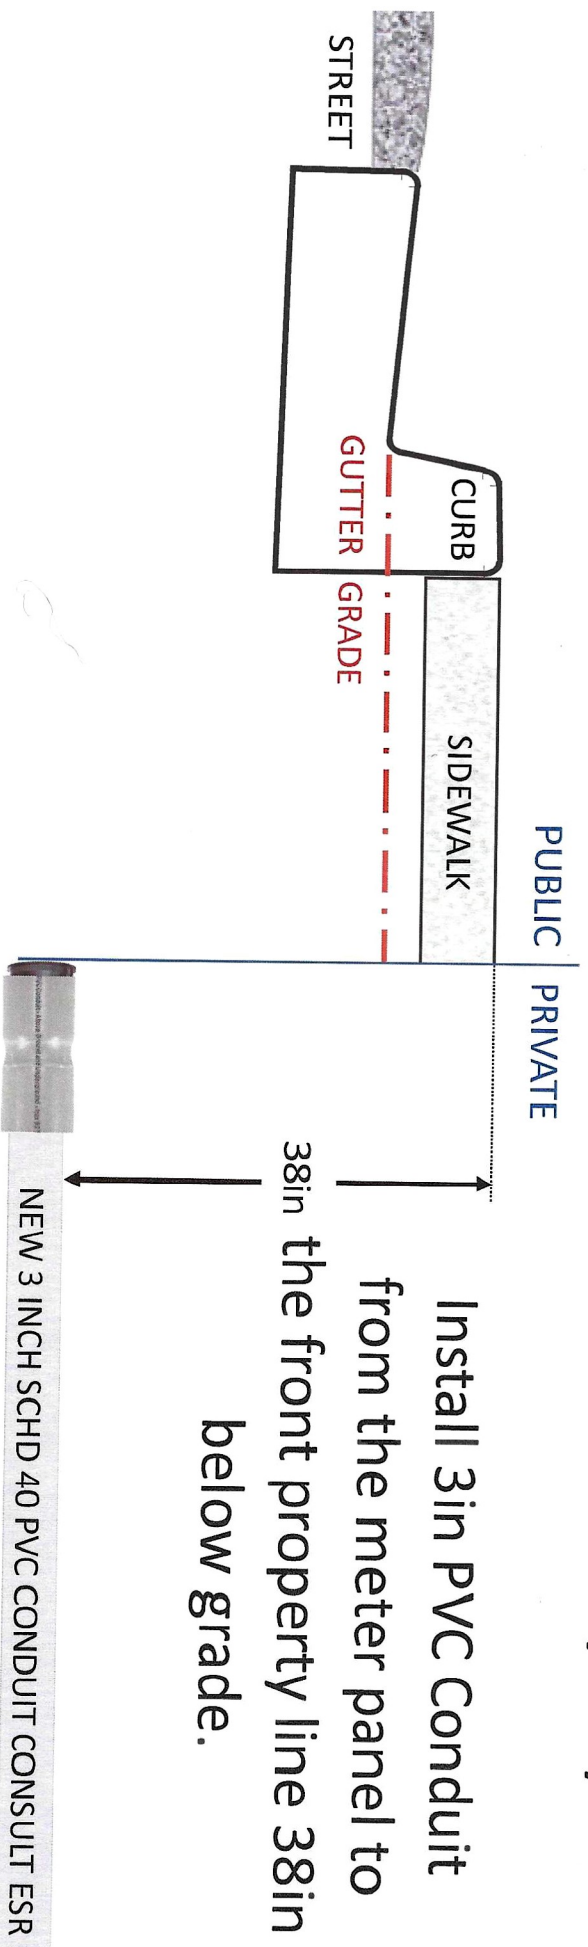

Future Underground Conduit Installed to the Public Property Line

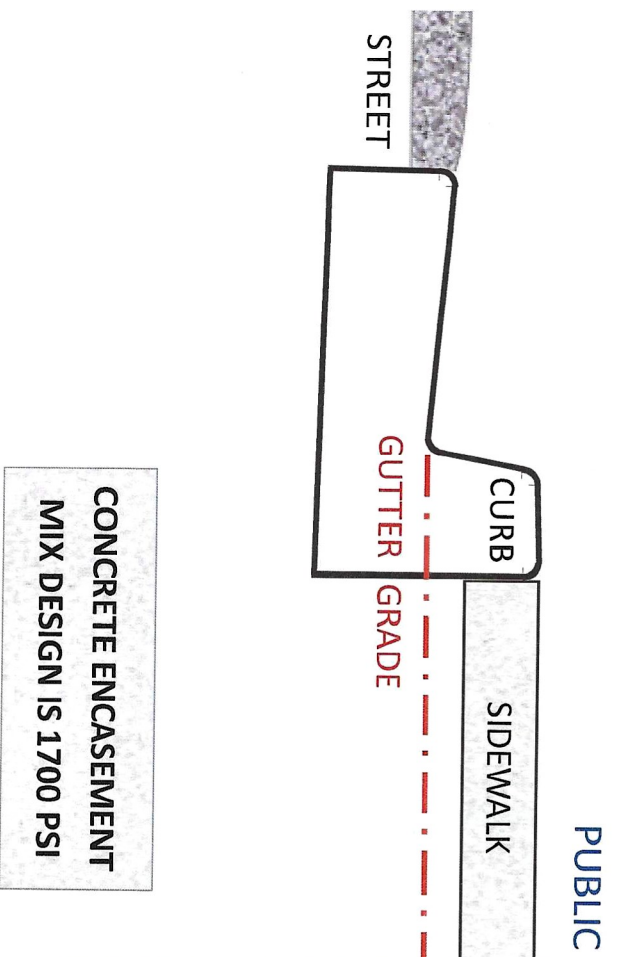

When Specified by LADWP to
Install 3" Conduit & Concrete
Encasement from the meter
panel to the front property line.
Top of the Encasement must be

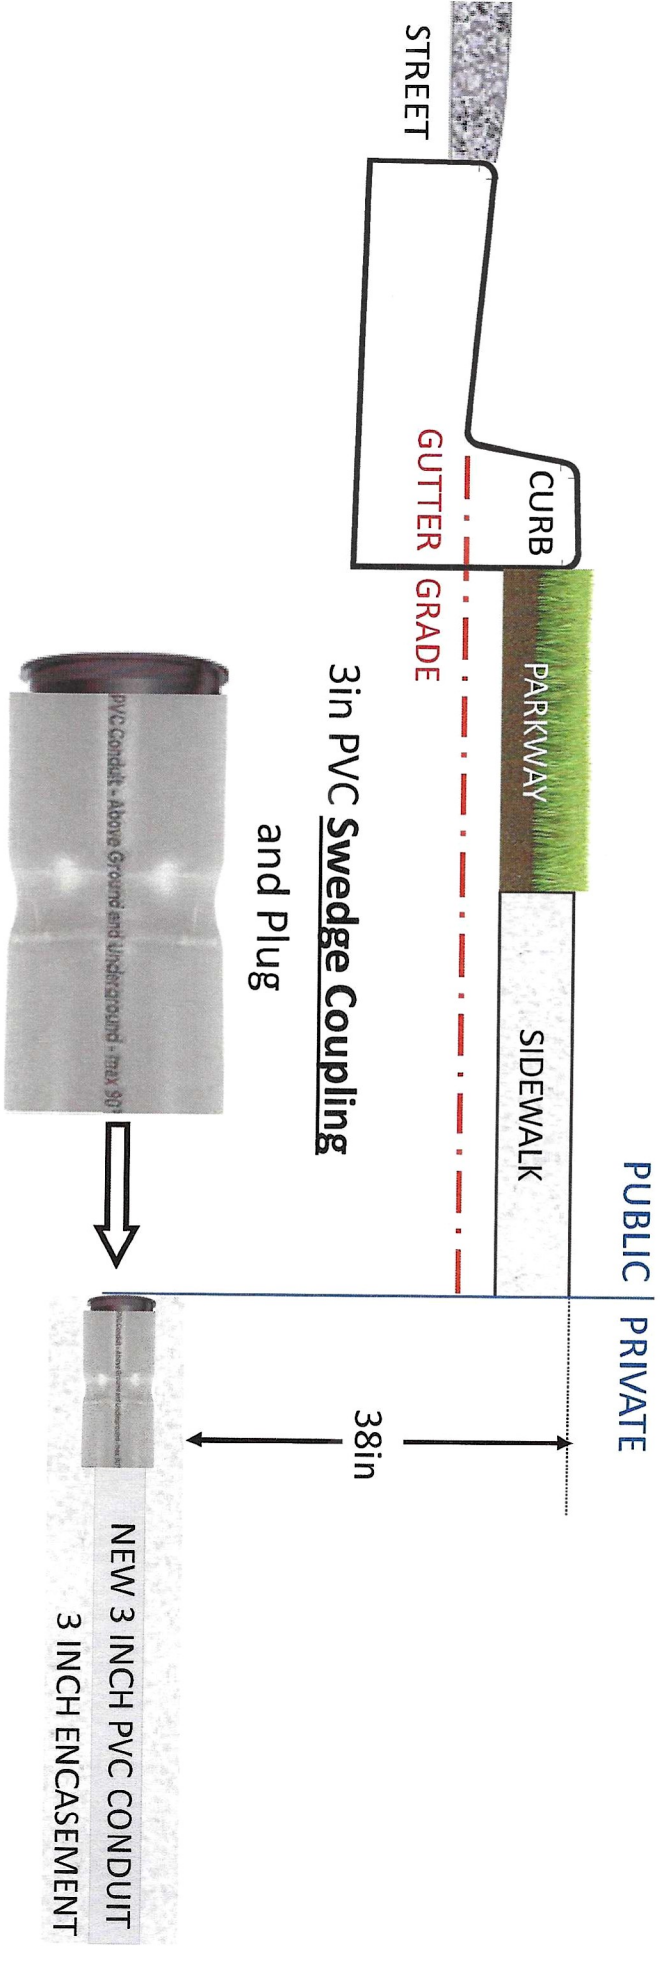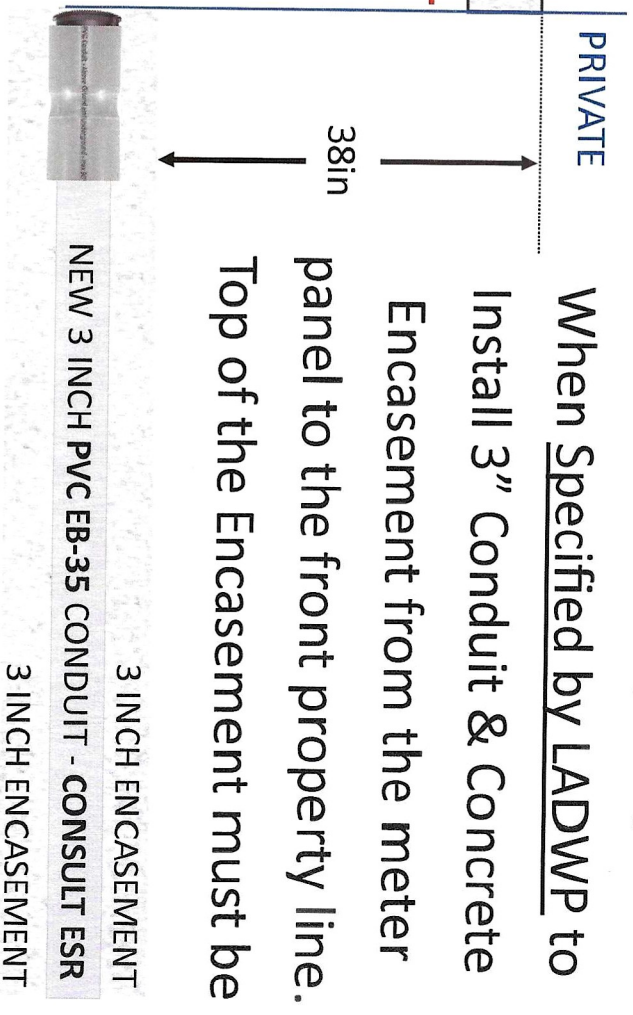

Full Scale 3 inch PVC Swedge Coupling



LADWP does not endorse any specific suppliers. The following sell Swedge Couplings:

Cantex, Carlon, Crescent Electric, Elliott Electric, Gordon Electric, JM Eagle, Platt, Thomas & Betts

LADWP Required PVC Clear Glue & Purple Primer Examples



Christy's™ PVC Solvent Cement Handy Pack

Christy's Conjunto Utilitario de PVC Cemento

Clear Cement

For most PVC pipe applications thru 4" diameter
Para todo tamaño de tubería de PVC con union hasta 4"

Purple Primer

VERY FAST SET

5 MIN. MAX. CURE

HOW TO VIDEO

MADE IN USA

Item# 33835

LOW VOC • HIGH PERFORMANCE

#30246V

Best size for most pipe installations!
¡Tamaño ideal para la mayoría de instalaciones de tuberías!





HANDY PACK CONJUNTO UTILITARIO



PURPLE PRIMER
PARA CPVC, PVC
IMPRIMADOR PÚRPURA

**REGULAR CLEAR
PVC CEMENT**
CEMENTO TRANSPARENTE
COMÚN TRANSPARENTE

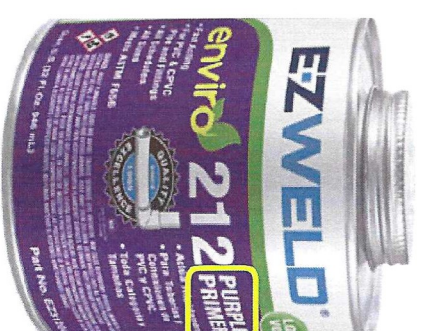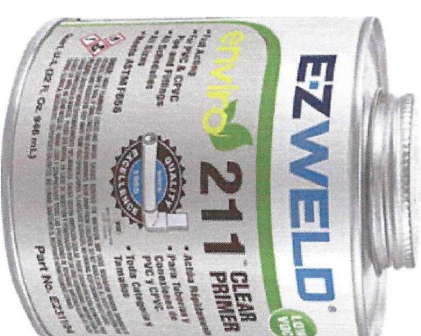

WELD-ON

**2-IN-1
TWIN PACK**

PLUMBING PVC CEMENT

PURPLE PVC PRIMER



**5 MINS SET/FRAGUADO
30 MINS CURE/CURADO**
Fraguado para tubería de
PVC dentro de 5 minutos


Primer para
tubería de PVC
↓
STORE UPRIGHT

CLEAR Transparente

PURPLE Morado

1/2 PINT (8 FL OZ) • Cont. Net. 237 mL
REGULAR BODY Viscosity/Viscosidad Regular FAS-1 SET SPC-10000 Rapidlo

1/2 PINT (8 FL OZ) • Cont. Net. 237 mL
PVC PREPARATION / Preparación de la tubería

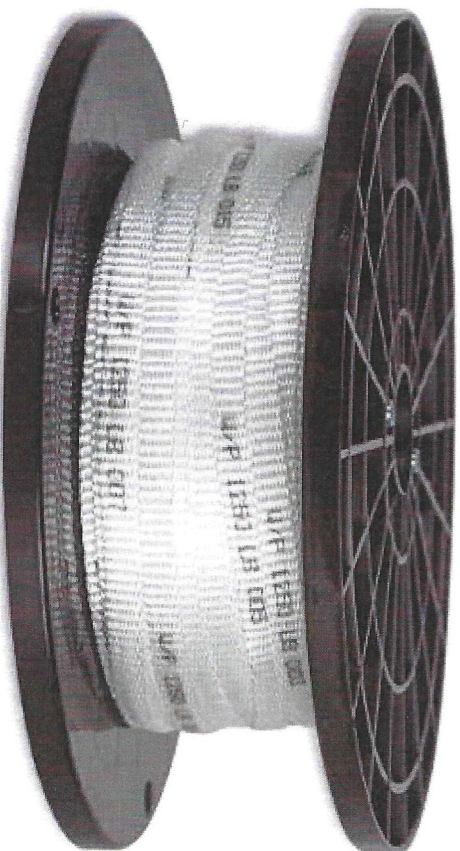

LADWP Conduit Pull Tape Requirements

21. Pulling Tape General Condition:


21(a). Install flat, woven multi-fiber polyester ribbon, minimum 3/8-inch nominal width and 1250-pound minimum tensile strength pulling tape in all ducts. The pulling tape shall be printed with the rated tensile strength and sequential footage markings with legible and stable print (no rub off). Fasten each tape to plugs on each end with 5'-0" minimum slack.

Typically called:

- Pull Tape
- Mule Tape
- Flat line

LADWP Required Pull Tape

Continuous Length (no knots) Multi-fiber Polyester Flat Line
Min. 3/8in, 1250 lb Tensile Strength with Footage Markings

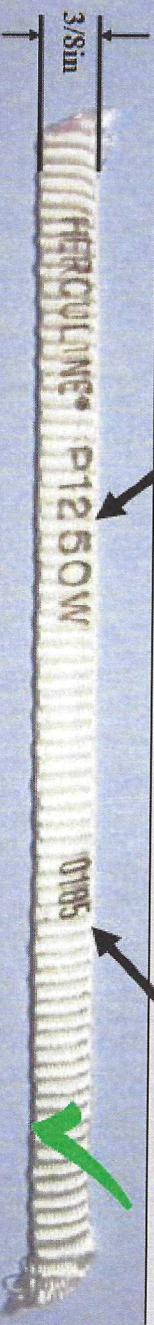

4 inch Conduit Duct Plugs used for Sealing a Conduit Dead End

Economy Tapered Conduit Duct Plug



Tab to tie on
the flat line



Quality Expansion Type Conduit Duct Plug